


PLAN

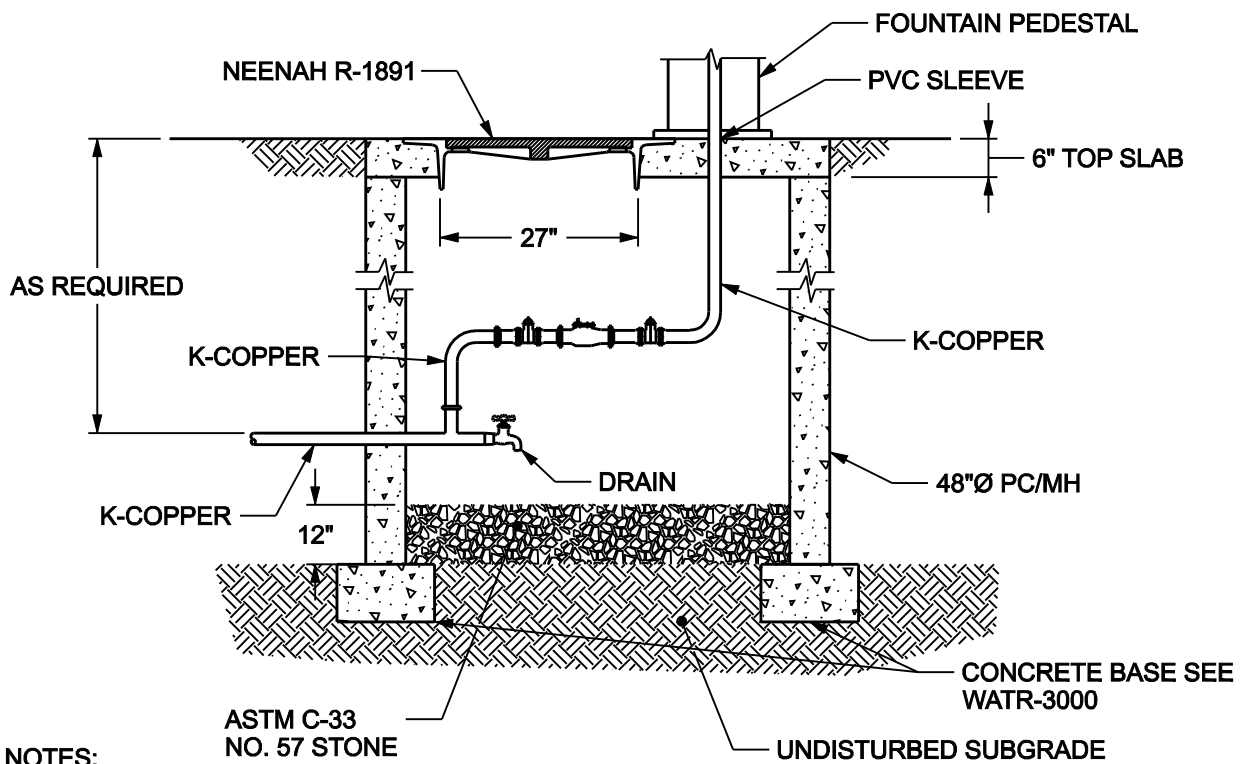

ELEVATION

NOTES:

1. NO GALVANIZED PIPE.
2. LEAD FREE FITTINGS/PIPING.
3. SERVICE CONNECTION TO WATERMAIN AS PER WATR-2002 OR FROM BUILDING MECHANICAL.
4. STOP BOX TO BE 8.0 FEET BELOW GRADE.
5. DRAIN SHALL NOT HAVE A THREADED CONNECTION.
6. CASTING INTEGRAL W/TOP SLAB.
7. DO NOT LOCATE METER PIT AT LOW POINT OF DRAINAGE RUN.

NOT TO SCALE



DRW: JAS

DATE: 4/12/16

APP: CMD

DATE: 4/12/16

VAULT METER
POTABLE

STANDARD
PLATE
NO.
WATR-2006